


Firewater Adequacy Analysis

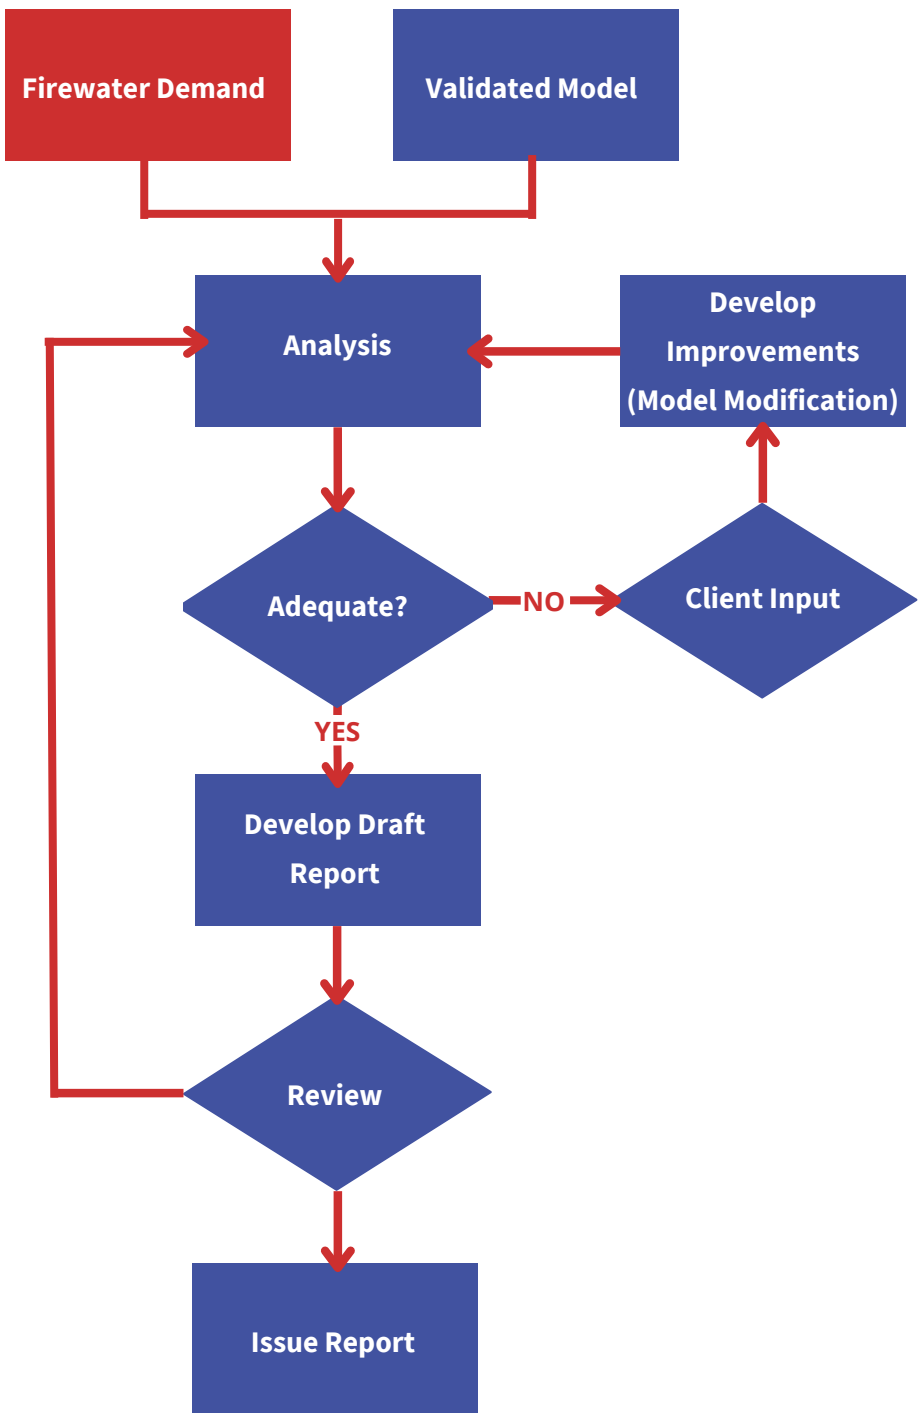

Inputs

- Validated firewater system model
- Firewater demand

Analysis

- Improvements may include pump and piping changes
- The goal is to reliably meet the firewater demand
- Improvements to reduce the firewater demand are outside the scope of this report (Fire Risk Report)

Develop Draft Report

- Drafts issued within 30 days
- To achieve an adequate and reliable firewater supply, an improvement plan will be included in the report.

Client Review

- Client confirms the report meets needs

Final Report

- Improvement plan will include short, mid, and long term goals